
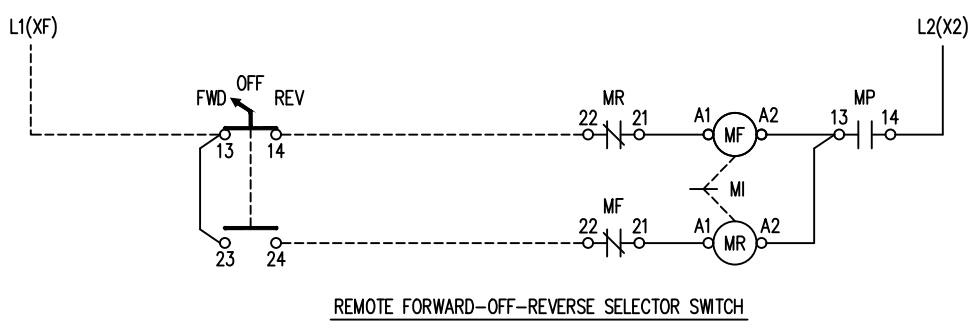
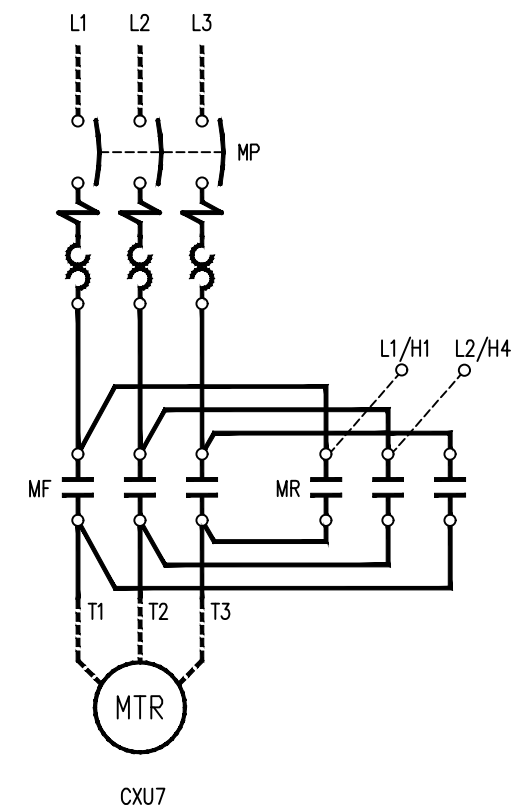


CUSTOMER TO SUPPLY PROPER BRANCH
CIRCUIT PROTECTION AS PER LOCAL CODES.
(USE 75°C COPPER WIRE ONLY)

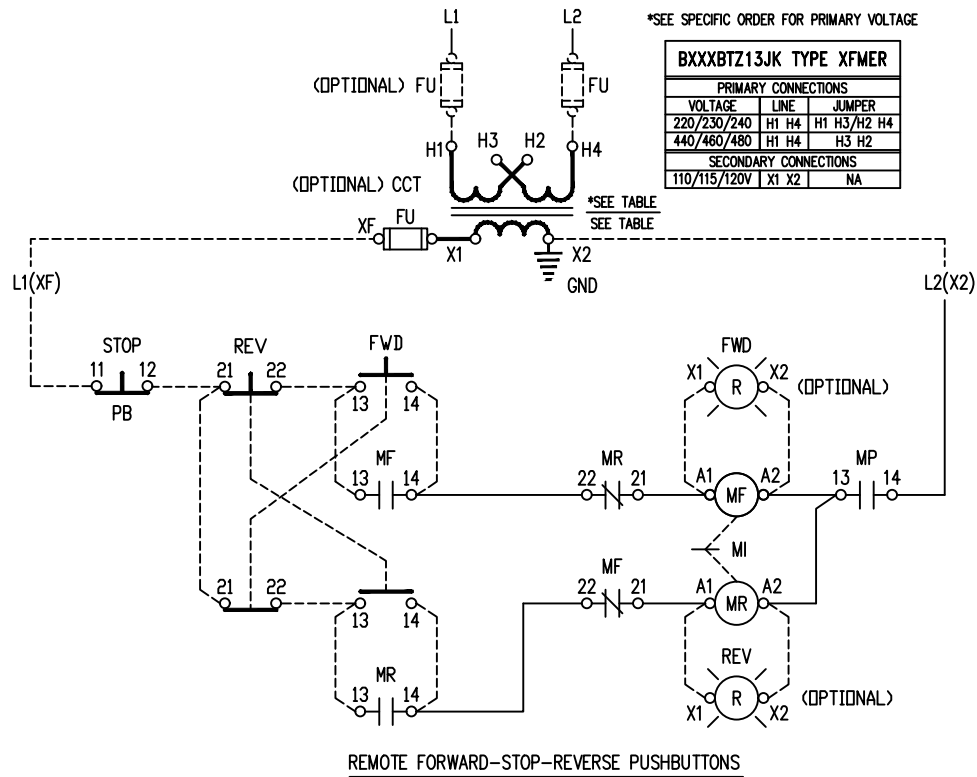

- NOTES:
- 1). X2 TERMINAL GROUNDED AS STANDARD, REMOVE IF NOT REQUIRED.
 - 2). MI: MECHANICAL INTERLOCK.
 - 3). MP: KT7 "TYPE E" MOTOR CONTROLLER.

-	-	-	-
-	-	-	-
-	-	-	-
1	GENERAL REVISION	6-30-06	JR
REV	CHANGE	DATE	BY

NOTICE

THIS DRAWING IS THE CONFIDENTIAL PROPERTY OF SPRECHER+SCHUH, INC and, as such, is subject to recall at any time. The drawing may not be reproduced, used or disclosed for any purpose except as authorized by SPRECHER+SCHUH, INC.

DRAWN BY:
JR
CHECKED BY:
GJG
APPROVED BY:
JR
DATE
2-08-01

TYPE E COMBINATION CONTROLLER
FULL VOLTAGE REVERSING
THREE PHASE
W/O COVER CONTROL

sprecher+
schuh HOUSTON, TEXAS

DWG. NO. CXU7 WS-114-04	SERIES 100
----------------------------	---------------